


7.97
7.65
7.63
7.49
7.48
7.37
7.36
7.34
7.28
7.27
7.26
7.25
6.84
6.83
6.72
6.71
6.69
6.69
6.67
6.67
5.24
5.22
4.88
4.87
4.68
4.66
4.64
4.47
4.46

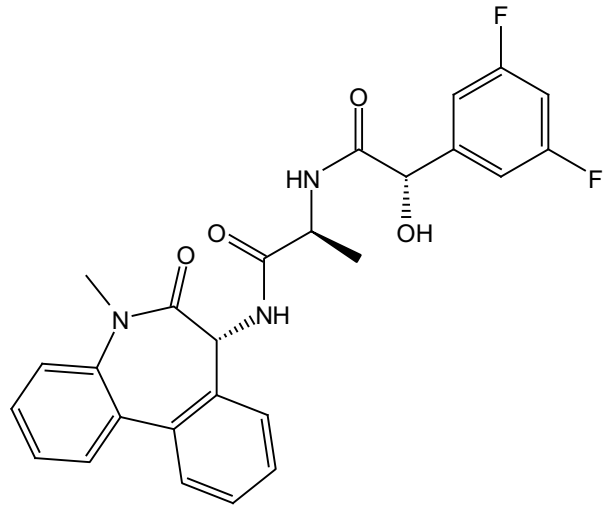

3.35


1.76

1.37

1.35

0.00

Parameter	Value
1 Title	A4019
2 Solvent	CDCl3
3 Acquisition Date	2014-03-17T15:29:57
4 Modification Date	2014-03-18T12:33:42
5 Spectrometer Frequency	400.13

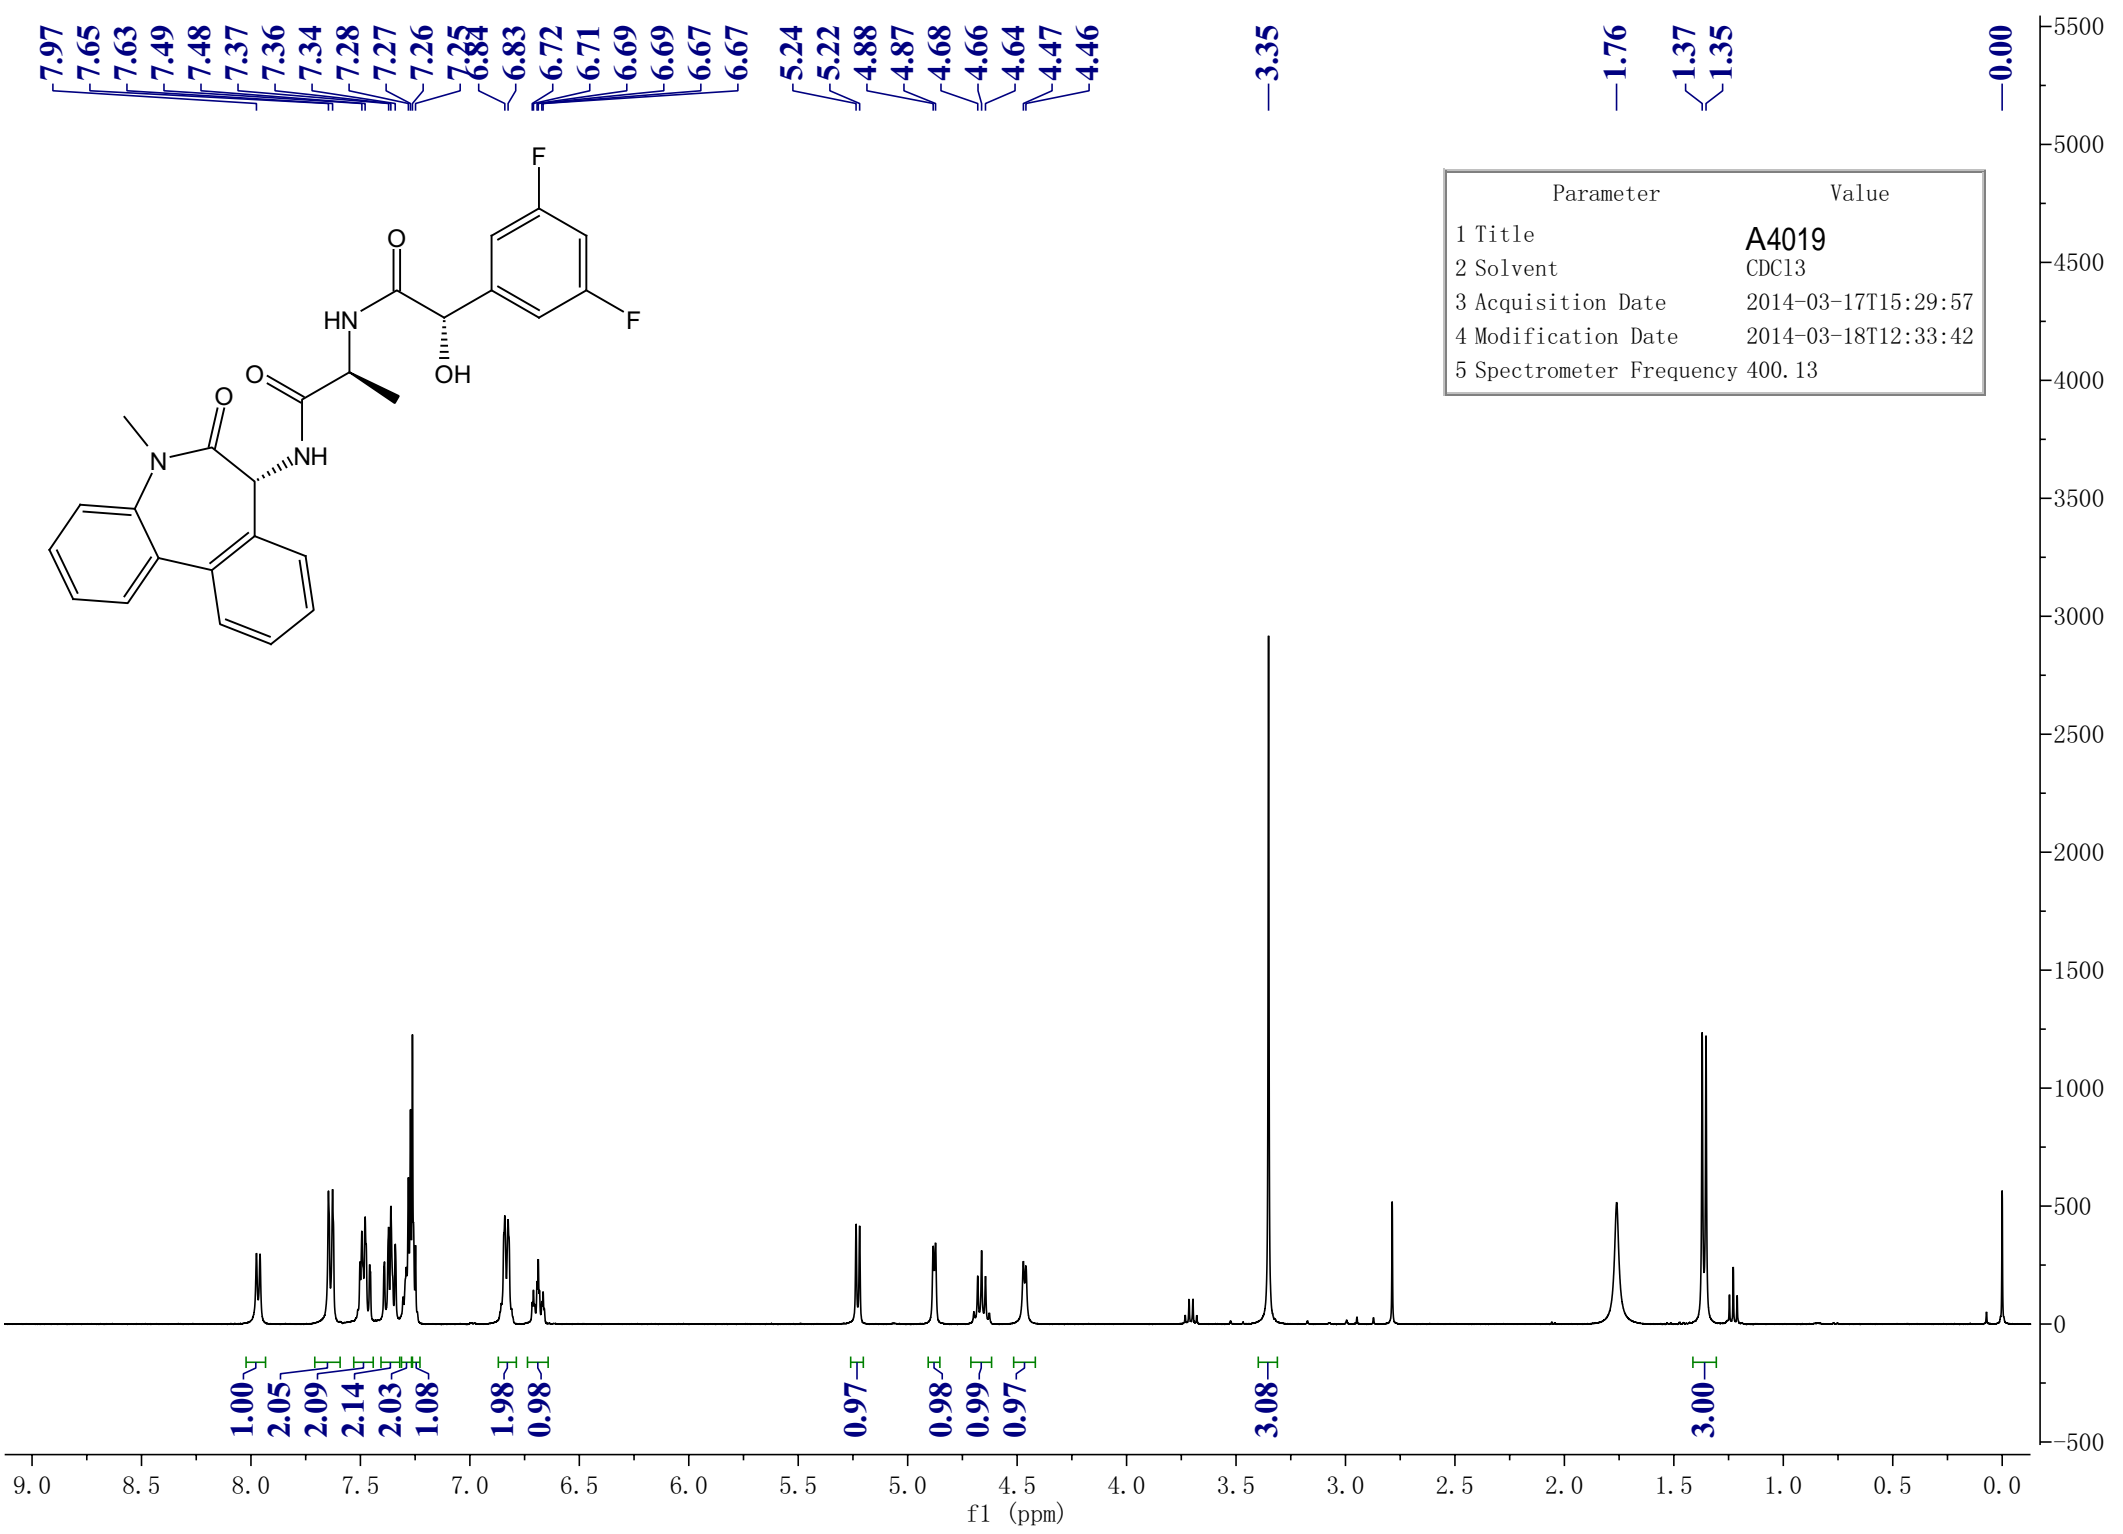

1.00

2.05

2.09

2.14

2.03

1.08

1.98

0.98

0.97

0.98

0.99

0.97

3.08

3.00

f1 (ppm)